



# ***Determination of Interruptible Water Available for 2026***

***Aaron Abel  
Water Services Manager***




# ***What is Interruptible Water?***

- **Firm water from reservoirs not used in the previous year**
- **Amount available varies from year to year depending on past water usage**
- **Availability established annually by the Board**
- **Sold at System Rate (Ag Rate for irrigation)**
- **Began supplying in 2008**




# Interruptible Water 2008 - 2025

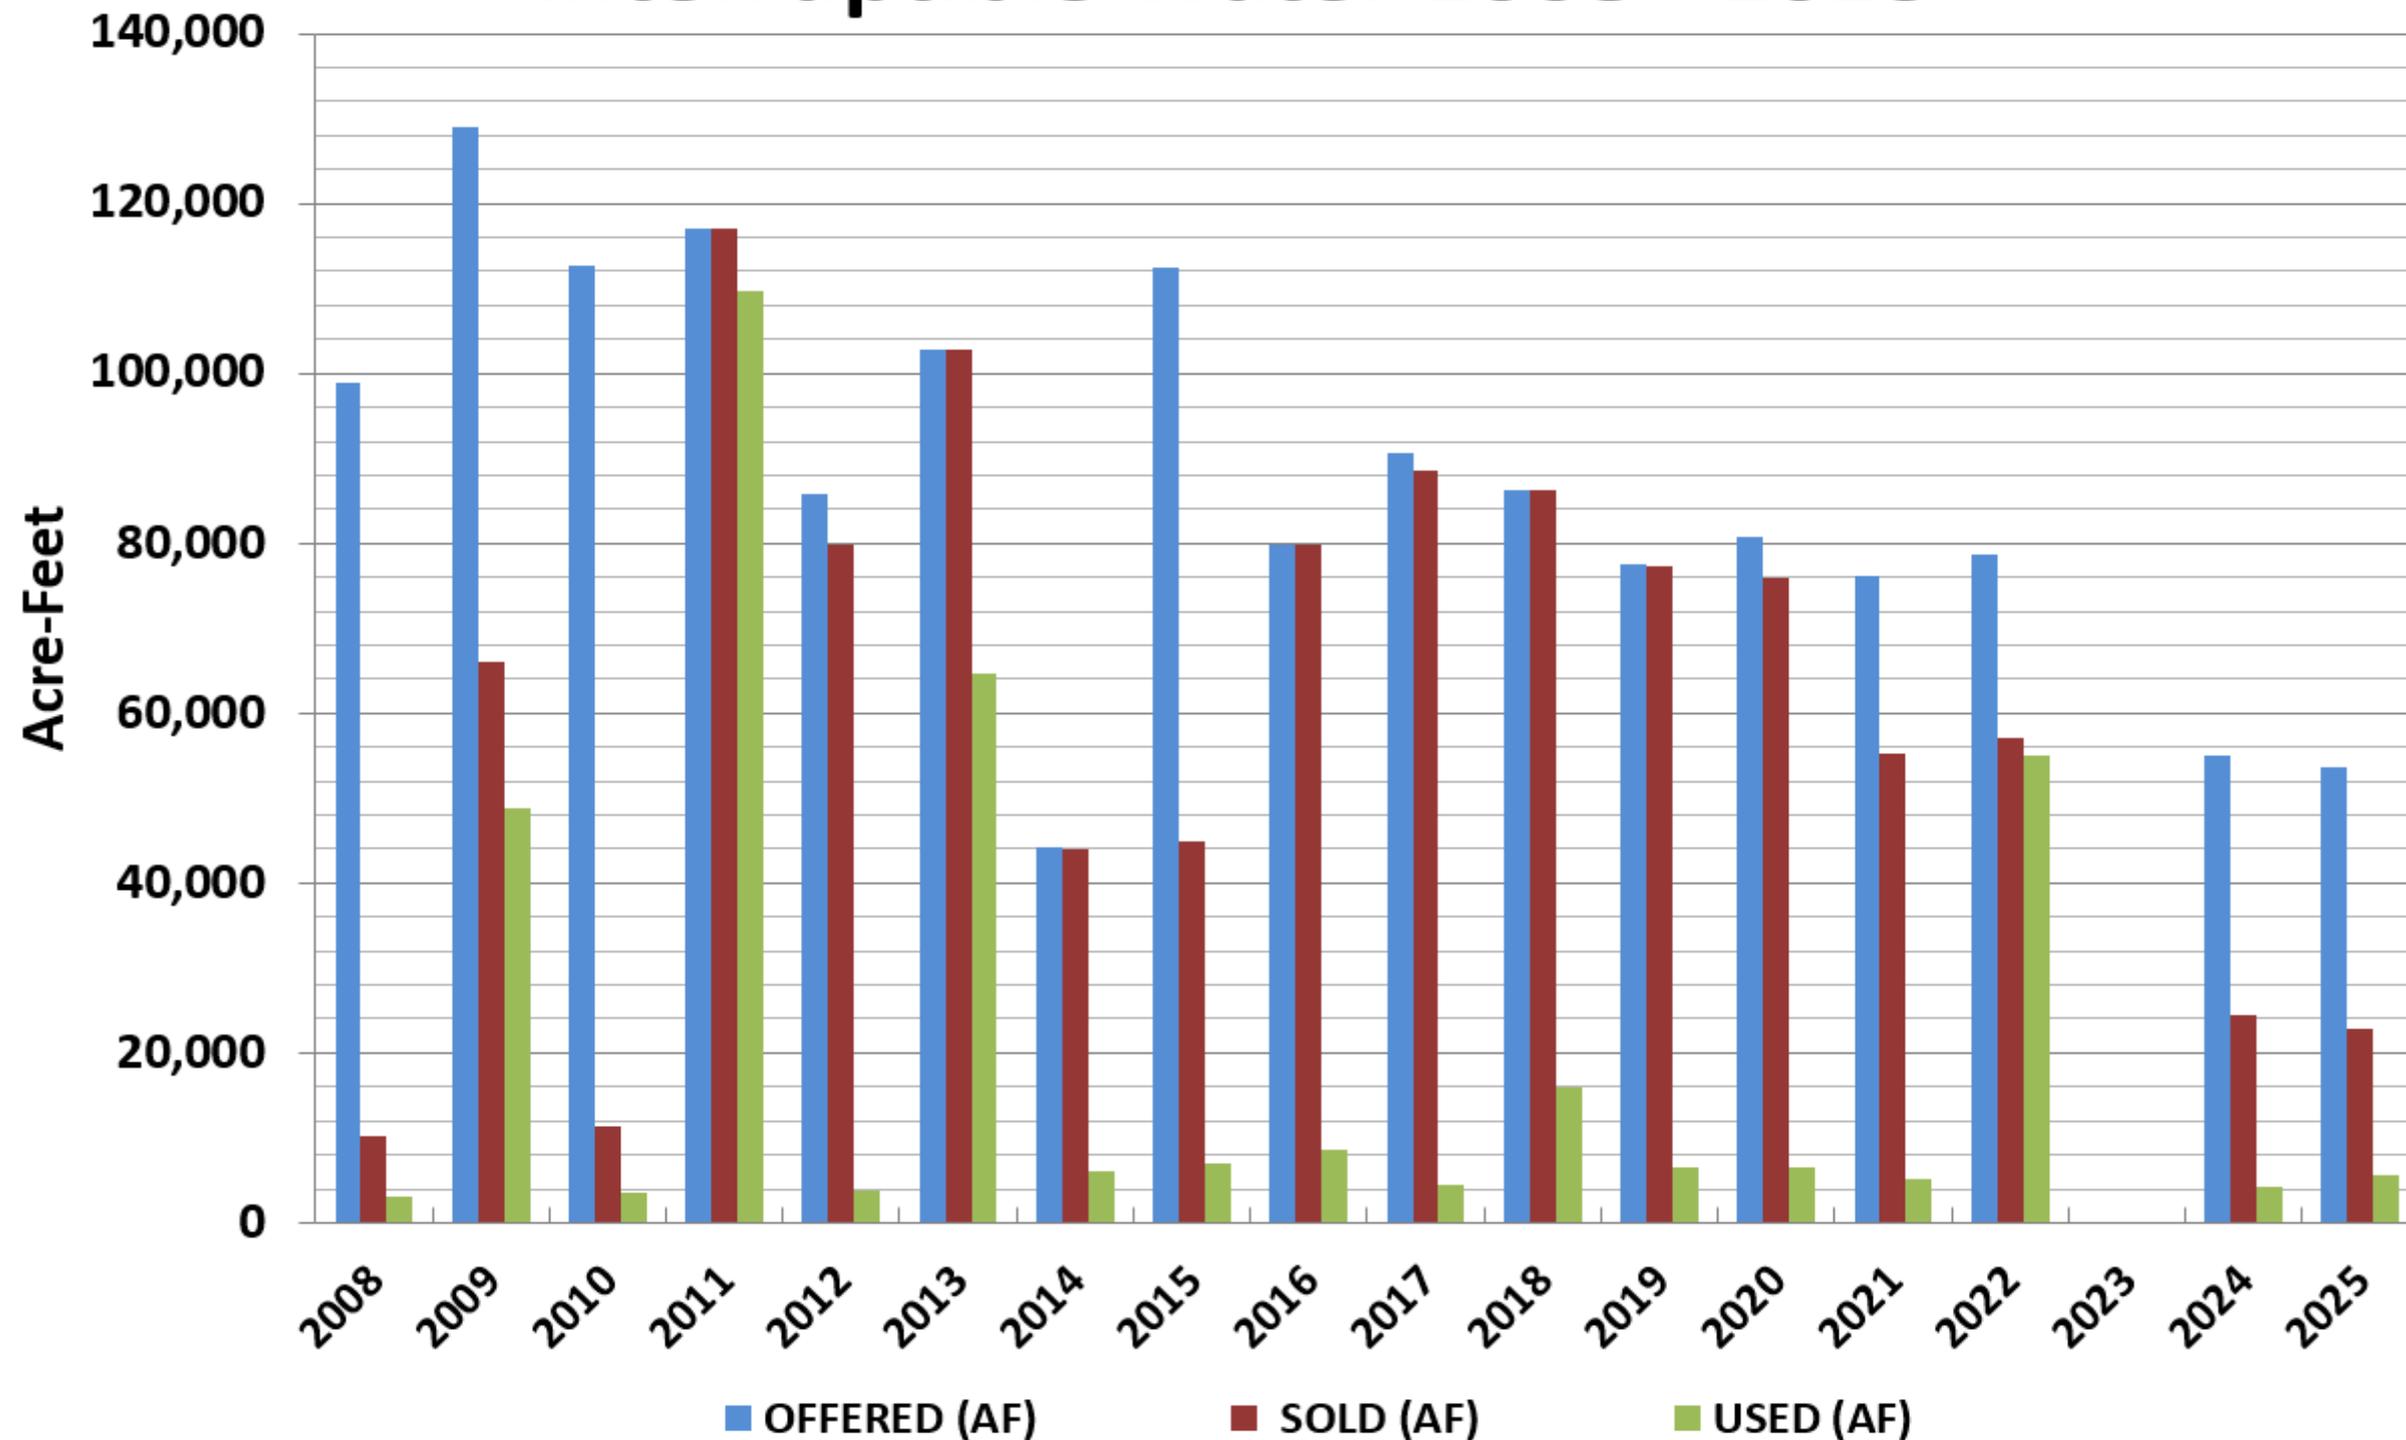



# Interruptible Water Requests For 2026

Use Type	
● Agriculture/Irrigation	6,780 AF
● Mining	3,750 AF
● Municipal	500 AF
<b>Total</b>	<b>11,030 AF</b>
<b>26 Requests (64 Diversions)</b>	

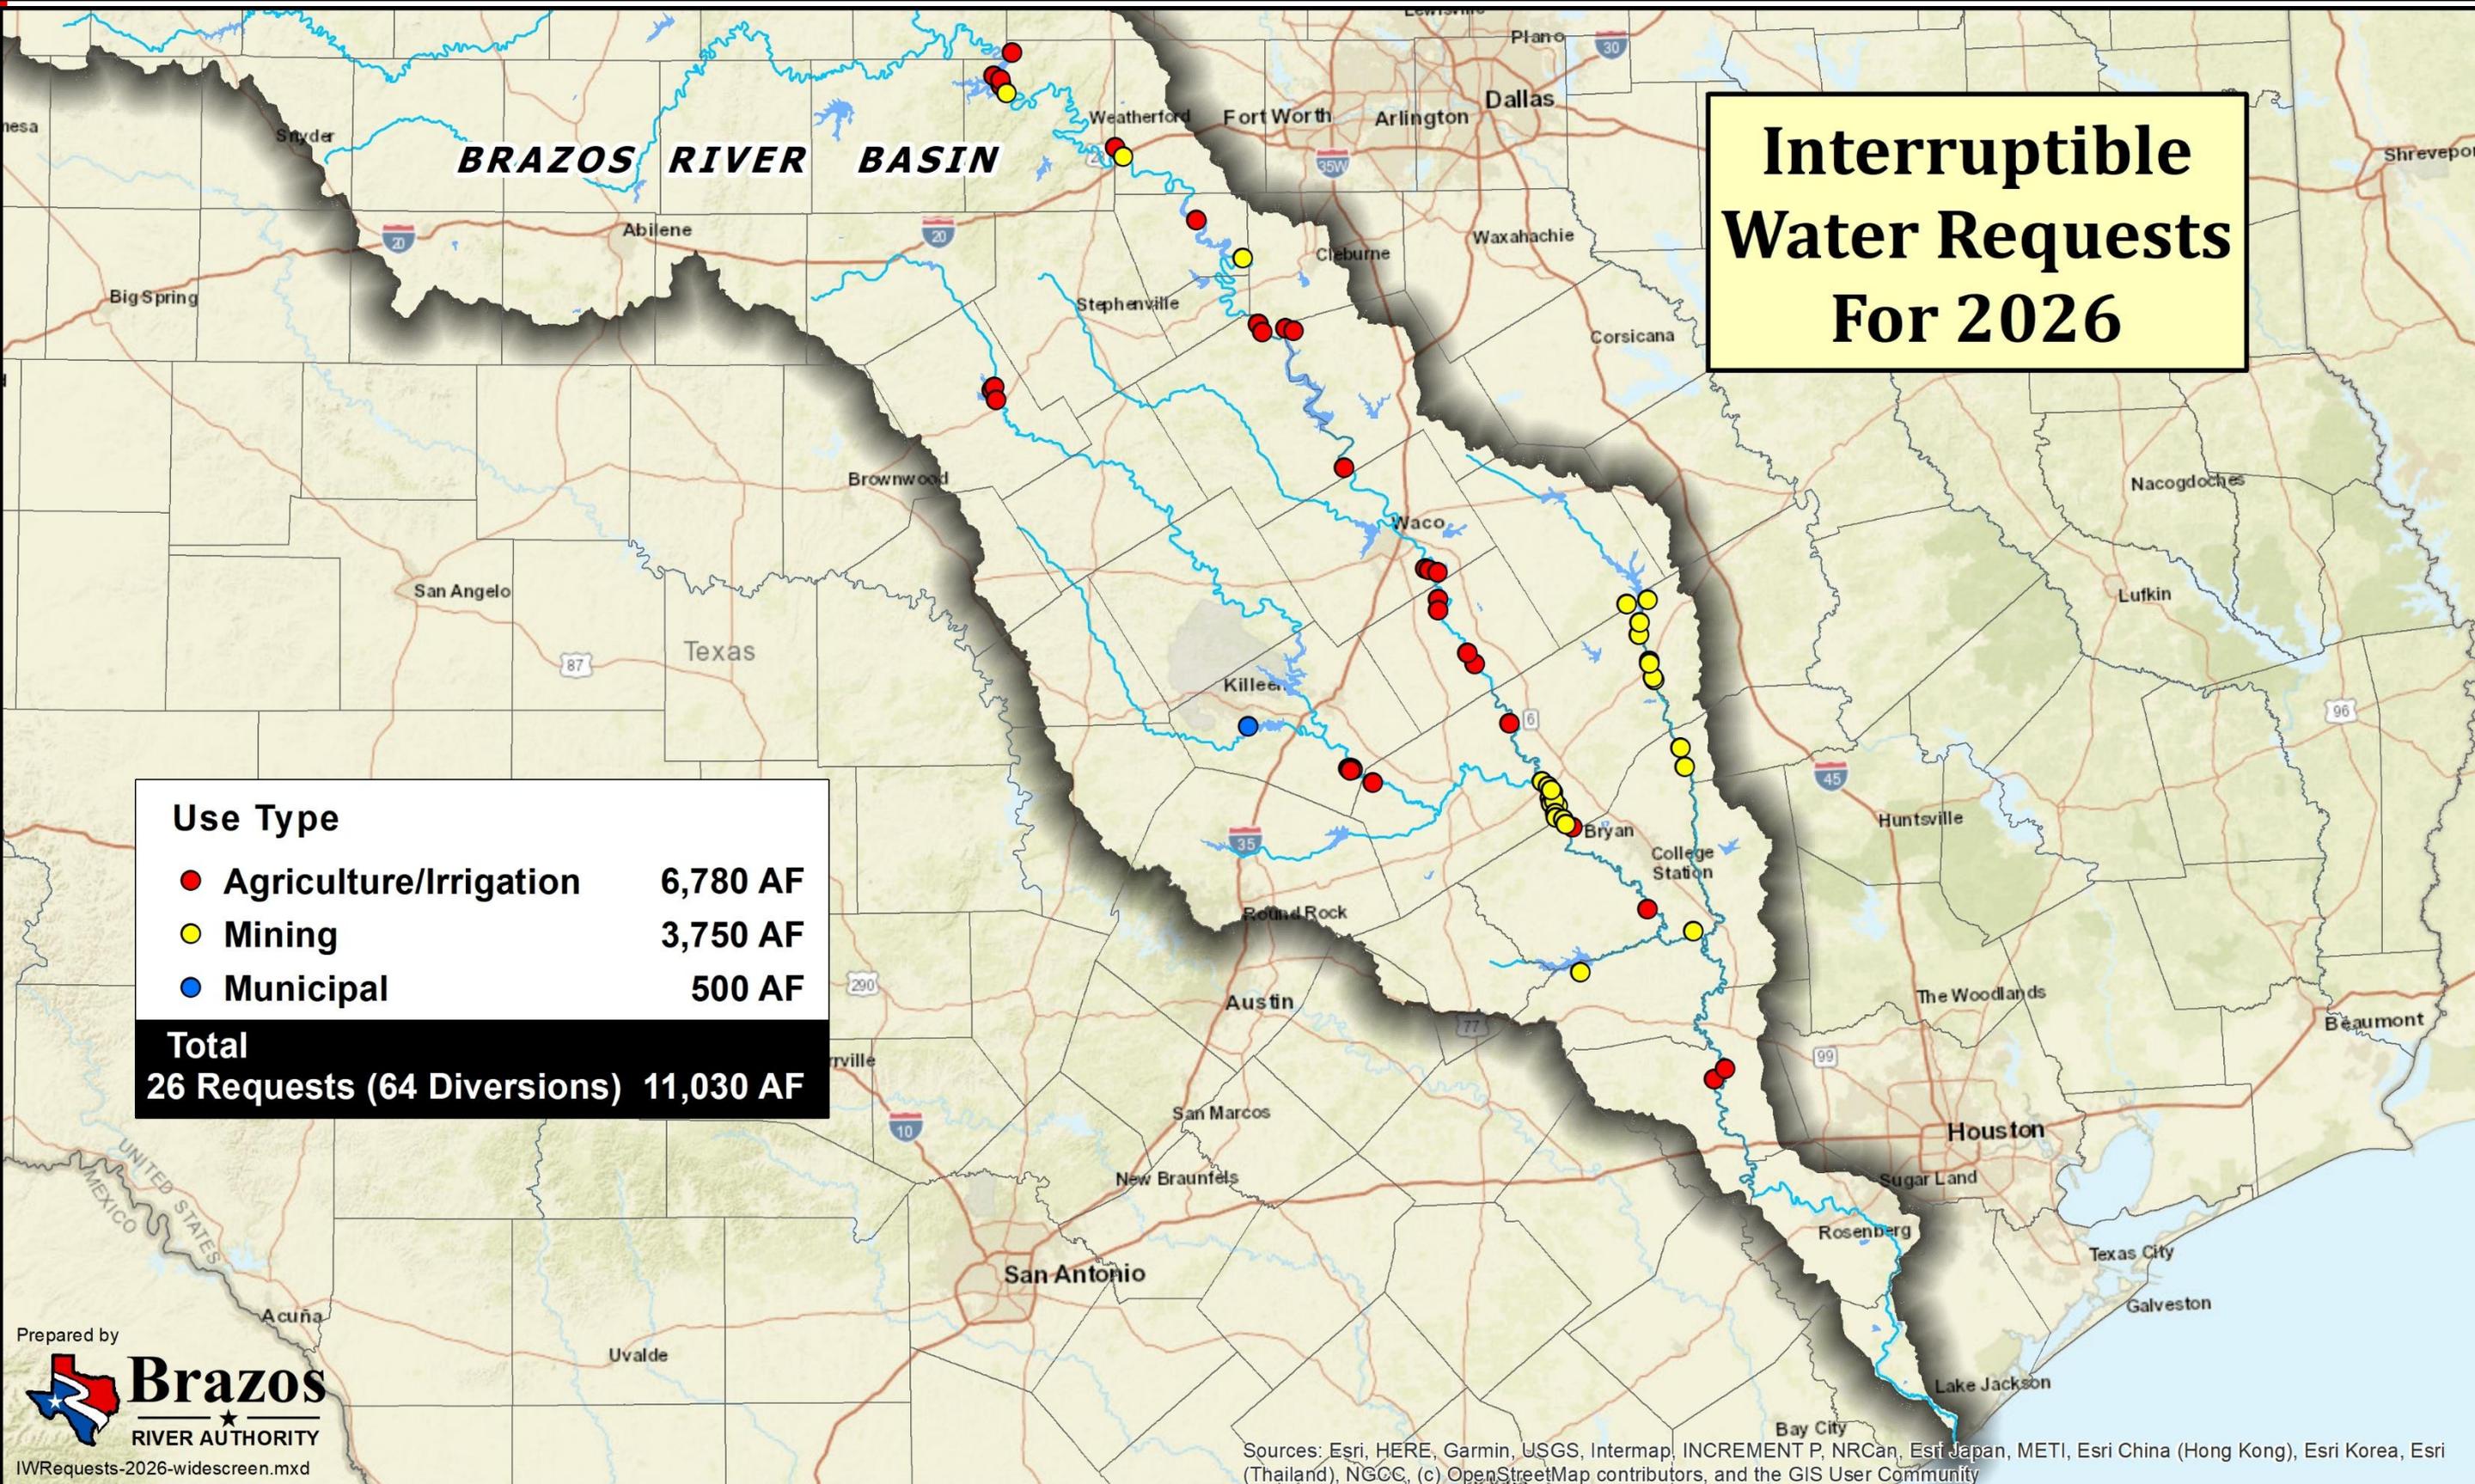




# Interruptible Water Availability by Segment

<b>RESERVOIR</b>	<b>2026 Available Interruptible Water</b>
	<b>(ACFT)</b>
<b>POSSUM KINGDOM</b>	
<b>GRANBURY</b>	
<b>WHITNEY</b>	
<b>AQUILLA</b>	33,084
<b>PROCTOR</b>	1,110
<b>BELTON</b>	
<b>STILLHOUSE</b>	
<b>GEORGETOWN</b>	
<b>GRANGER</b>	
<b>SOMERVILLE</b>	17,951
<b>LIMESTONE</b>	5,100
<b>TOTAL:</b>	6,558
	<b>63,803</b>

# BRA Water Supply Reservoirs "PERCENT FULL" October 22, 2025

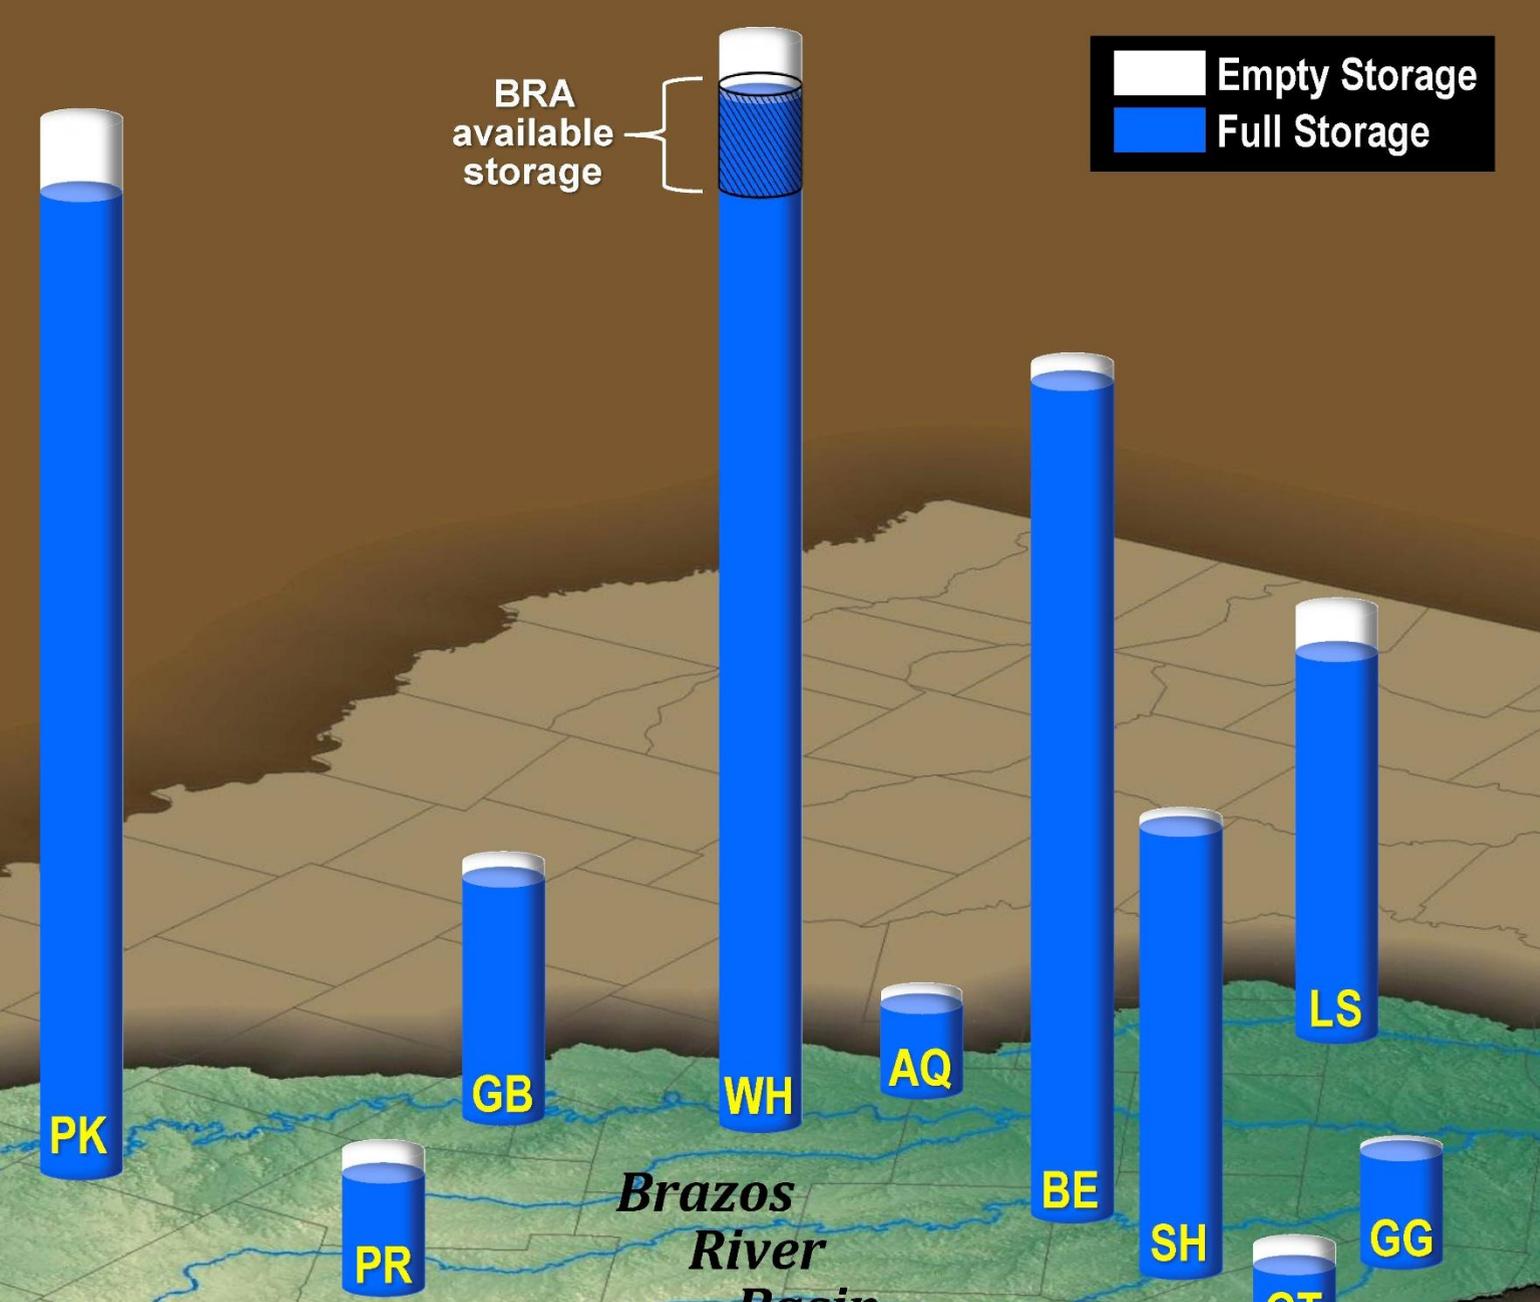

	% Full	2 Week % Change	** Drawdown	2 Week Change (ft)
<b>PK</b> Possum Kingdom Lake	93%	- 2%	- 2.1	- 0.5
<b>GB</b> Lake Granbury	93%	- 1%	- 1.1	- 0.2
<b>WH</b> Lake Whitney	*95%	- 3%	- 1.4	- 0.7
<b>AQ</b> Lake Aquilla	89%	- 3%	- 1.6	- 0.4
<b>PR</b> Lake Proctor	81%	- 3%	- 2.3	- 0.4
<b>BE</b> Lake Belton	98%	- 1%	- 0.6	- 0.4
<b>SH</b> Stillhouse Hollow Lake	98%	- 1%	- 0.6	- 0.5
<b>GT</b> Lake Georgetown	74%	- 3%	- 8.4	- 1.0
<b>GG</b> Lake Granger	95%	- 3%	- 0.6	- 0.3
<b>LS</b> Lake Limestone	89%	- 2%	- 1.8	- 0.4
<b>SV</b> Lake Somerville	84%	- 6%	- 2.2	- 0.8
<b>SYSTEM TOTAL</b>	93%	- 2%		

\* Total Lake Whitney storage.  
 BRA available storage is 93% full  
 \*\* Feet below full

- Stage 1 Drought Watch
- Stage 2 Drought Warning
- Stage 3 Drought Emergency
- Stage 4 Pro-rata Curtailment



# ***Recommendations***

- **Authorize the General Manager/CEO to enter Interruptible Water Availability Agreements for the total calculated amount of 63,803 acre-feet for 2026**



**“BE IT RESOLVED that the Board of Directors of the Brazos River Authority hereby approves a Safety Factor of 0.25 for use in determining the amounts of Interruptible Water to make available in calendar year 2026.**

**BE IT FURTHER RESOLVED that the Board of Directors of the Brazos River Authority hereby authorizes the General Manager/CEO to make up to 63,803 acre-feet of Interruptible Water available in calendar year 2026.”**



Brazos River Authority



**Brazos**

— ★ —  
**RIVER AUTHORITY**